


TYPICAL CONDUIT INSTALLATION

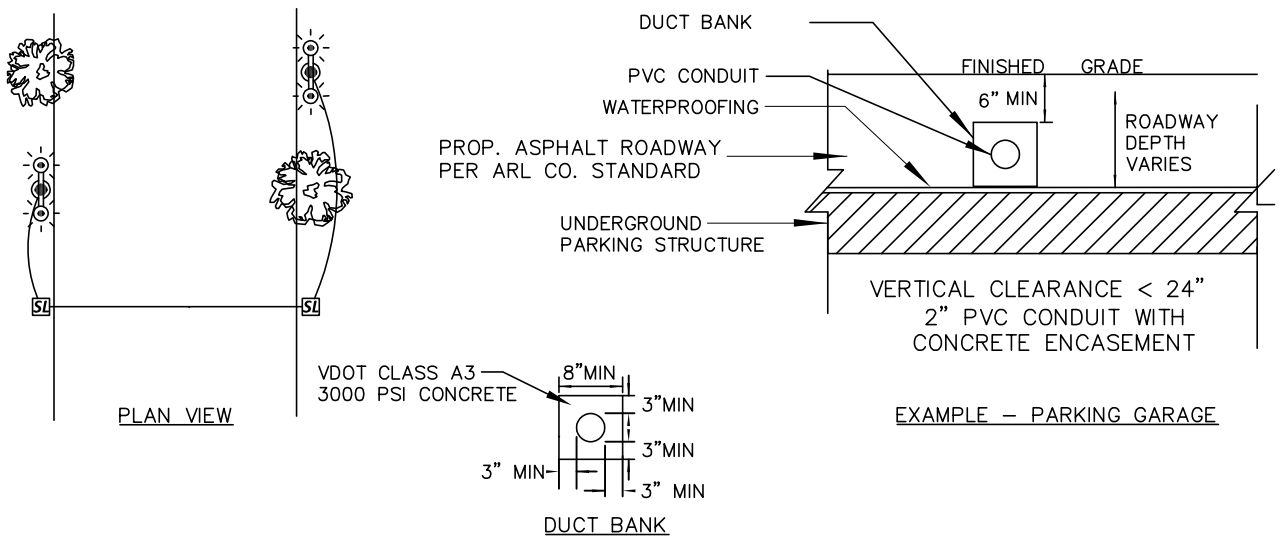

NOTES:

1. TYPICAL CONDUIT INSTALLATION SHALL BE INSTALLED A MINIMUM OF 24" & NO MORE THAN 36" BELOW FINISH GRADE.

LIGHTING CONDUIT INSTALLATION

1 09/23

REVISION & DATE



ARLINGTON COUNTY, VIRGINIA  
DEPARTMENT OF ENVIRONMENTAL SERVICES

DRAWING NO.  
**14030-01**